

PRODUCT DATA SHEET

Control Systems

Transmitters

Sensors

Accessories

TOCSIN 102 Series Infra Red Gas Detectors

4-20mA Device 3 Wire

- Addressable Versions
- Compact Size
- EExd Certified
- ATEX Certified
- Ingress Protection IP66

Available as:

- 0- 100% LEL (State Flammable Gas)
- 0- 100% Volume (as Methane)
- 0- 5000ppm CO2
- 0- 5% Volume CO2
- 0- 100% Volume CO2



Tocsin 102 Series Infra Red gas detectors utilise the latest technology to provide small format high reliability gas detection in an ATEX package. High stability is ensured by using dual beam technology with dual detectors for sample and reference channels. Temperature compensation and linearity correction are built in giving a fully linearised output. The basic detector is available as a three wire 4-20mA transmitter with the option for a fully digitally addressable version for use with the latest IGD systems. Detectors are supplied pre-calibrated for the chosen range and target gas.

General Specification

Power supply	18 to 28V DC
Electrical Outputs	3 Wire 4-20mA (4 Wire Addressable Option)
Temperature	-20°C to +55°C
Humidity	15 to 90% RH non-condensing
Ingress Protection	IP66
Housing Material	Stainless Steel 316 S16
Protection Concept	Flameproof
Dimensions (mm)	50 Diameter x 80 Length
Mounting Thread	M20 x 1.75
Weight	550 grams (Infra Red)







102 Series Detector

II 2G Ex db IIC T6 Gb
II 2D Ex tb IIIC T85°C Db
Ta = -20°C to +40°C
II 2G Ex db IIC T5 Gb
II 2D Ex tb IIIC T100°C Db
Ta = -20°C to +55°C
Rating 12-32VDC 2W
IECEx EXV16.0003X
ExVeritas 16ATEX0141X
ExVeritas 21UKEX0914X

Document Ref: ROS165 V7 Page 1



 internationalgasdetectors.com
 +44 (0)161 483 1415
 sales@internationalgasdetectors.com
 /international-gas-detectors-ltd

Triton House
Crosby Street
Stockport
SK2 6SH

* Terms and Conditions Apply

Always use latest version data sheets from IGD website

EC Declaration of Conformity

Issuers name and address:

Oliver IGD Limited of
Triton House
Crosby St,
Stockport,
United Kingdom



TOCSIN 102IR

Infra Red point flammable hydrocarbon gas detector
certified for use in potentially explosive atmospheres

Are in conformity with the provisions of the following European Directive(s) when installed, operated, serviced and maintained in accordance with the installation and operating instructions contained in the product documentation.

2004/108/EC **EMC Directive**
2014/34/EU **ATEX Directive**

And that the standards and/or technical specifications referenced below have been applied or considered.

IEC 60079-0:2017 7th Ed	Explosive Atmospheres Equipment General Requirements
IEC 60079-29-1:2016 2nd Ed	Explosive Atmospheres. Gas Detectors. Performance Requirements of Defectors for Flammable Gases.
IEC 60079-1	Equipment protection by flameproof enclosures 'd'
EN 50270	Electromagnetic compatibility - Electrical Equipment for the Detection and Measurement of Combustible Gases, toxic Gases or Oxygen
IEC 60529	Degree of Protection to IP66
EN 60068-2-6	Vibration
EN 50271	Electrical apparatus for the detection and measurement of combustible gases, toxic gases or oxygen. Requirements and tests for apparatus using software and/or digital technologies
EN 60335:2012+A11:2014	Electrical Safety
IEC 61010-1:2010 +A1:2016	Safety requirements for electrical equipment for measurement, control, and laboratory use
EN 61010-1: 2010 +A1:2019	
Technical File Reference	T102A-TF9 and AD197 ATEX/IECEX Approval Document File

Product Markings



II 2G Ex db IIC T6 Gb
II 2D Ex tb IIIC T85°C Db
Ta = -20°C to +40°C
II 2G Ex db IIC T5 Gb
II 2D Ex tb IIIC T100°C Db
Ta = -20°C to +55°C
Rating 12-32VDC 2W
IECEX EXV16.0003X
ExVeritas 16ATEX0141X
ExVeritas 21UKEX0914X



Serial Number- XXXXXXXX



Quality Assurance Certificate Number
16PQAN0014
Quality Assurance Notification Number:
2585




Oliver IGD Limited operate an independently assessed ISO9001:2015 Quality Management and ISO14001:2015 Environmental Management System

Certificate Numbers
FS0646773 & EMS696504

EMC Tested by:

TUV - SUD
Octagon House
Concorde Way
PO 15 5RL Fareham



Certificate Number
E8N 15 02 91327 002



Units 16-18 Abenbury Way,
Wrexham Industrial Estate,
Wrexham, LL13 9UZ
United Kingdom

BSI Assurance UK LTD,
London, W4 4AL
United Kingdom

TUV Certificates and reports can be checked on-line at
https://www.tuev-sued.de/industry_and_consumer_products/certificates
Select Oliver IGD when prompted on the website to view certificates

Issued by: Oliver IGD Limited, Stockport, SK2 6SH, United Kingdom

Signature:  Declaration of Conformity in accordance with EN ISO/IEC 17050-1:2010

Name: Andrew J Collier M.I.O.D

Position: Managing Director Date: 15 June 2021 Declaration Ref: 102IRCE-5

Document Ref: ROS165 V7 Page 2



 internationalgasdetectors.com Triton House
 +44 (0)161 483 1415 Crosby Street
 sales@internationalgasdetectors.com Stockport
 /international-gas-detectors-ltd SK2 6SH

TOCSIN 102

Infra Red Point Gas Detectors

The Tocsin 102IR series of gas detectors uses the proven Non-Dispersive (NDIR) principle to detect and monitor the presence of gases.

The detectors are supplied as pre-calibrated units with linear 4-20mA outputs. If necessary the detector head can be field calibrated or re-configured for different gases or ranges using its inbuilt serial port and separate data terminal. The infra red detectors employed have been field proven over many years use resulting in a series of detector heads with excellent stability and reliability in the most arduous conditions. The detector heads have their own control software which continually monitors the head performance. This ensures that in the unlikely event that a fault occurs it is detected and reported immediately. Using the inbuilt serial port this series of detector heads can be integrated onto addressable systems such as the Tocsin 625,700 or 920 control panels allowing sensors to be 'daisy' chained for ease of installation and operation.

- **LONG MTBF**

EXTENDED CALIBRATION PERIODS

ALL STAINLESS STEEL CONSTRUCTION

ADDRESSABLE SERIAL PORT

- **CAN BE FIELD CALIBRATED**

- **LINEAR 4-20mA OUTPUT**

- **AVAILABLE FOR A WIDE RANGE OF FLAMMABLE GASES AND CO2**

Performance	
Operation	Continuous
Resolution	2%FSD
Warm up time to final zero	< 20 s
Warm up time to specification	< 30 minutes
Response time to target gas T90	< 20 s
MTBF	> 5 years
Long Term Zero Drift Per Month	+/-0.05%
Zero Repeatability During Operation	+/-0.1%
Span (5%) Repeatability During Operation	+/-0.1%
Environmental:	
Operating Temperature	-10 to +55 Deg C
Storage Temperature	-20 to +60 Deg C
Relative humidity (non-condensing)	0 to 100%
Connections	
Outputs	3 Wire 4-20mA
Power Input	18 to 32V DC
Power Consumption	90mW
Physical	
Ingress Protection	IP66
Housing Material	Stainless Steel 316 S16
Protection Concept	Flameproof
Dimensions (mm)	50 Diameter x 80 Length
Mounting Thread	M20 x 1.75
Weight	550 grams

4-20mA Output Range	
2.0mA	Fault
3.2mA	-10% Full Scale
4.0mA	0 (Zero)
20.0mA	Full Scale
21.6mA	110% Scale

Gases, Ranges and Order Codes

Sensor type	Basic Part Number	Suffix 'A' For Addressable Sensor	Min Range	Max Range
Flammable Gases Infra-Red Point Methane Petrol Vapour Propane Common Solvents n-Butane Kerosene n-Pentane Ethylene n-Hexane Benzene	5107901	A		0-100%LEL 0-100%Vol
Carbon Dioxide Infra-Red Point	5112701 5112702	A A		0-5000ppm 0-5% 0-100%


METHANE
 PROPANE
 BUTANE
 PENTANE
 HEXANE
 ETHYLENE
 BENZENE
 AIRCRAFT FUEL JP-4
 PETROL VAPOURS



TOCSIN 102

SENSOR OPTIONS & ACCESSORIES


TOCSIN 102 SHOWN WITH EExd JUNCTION BOX

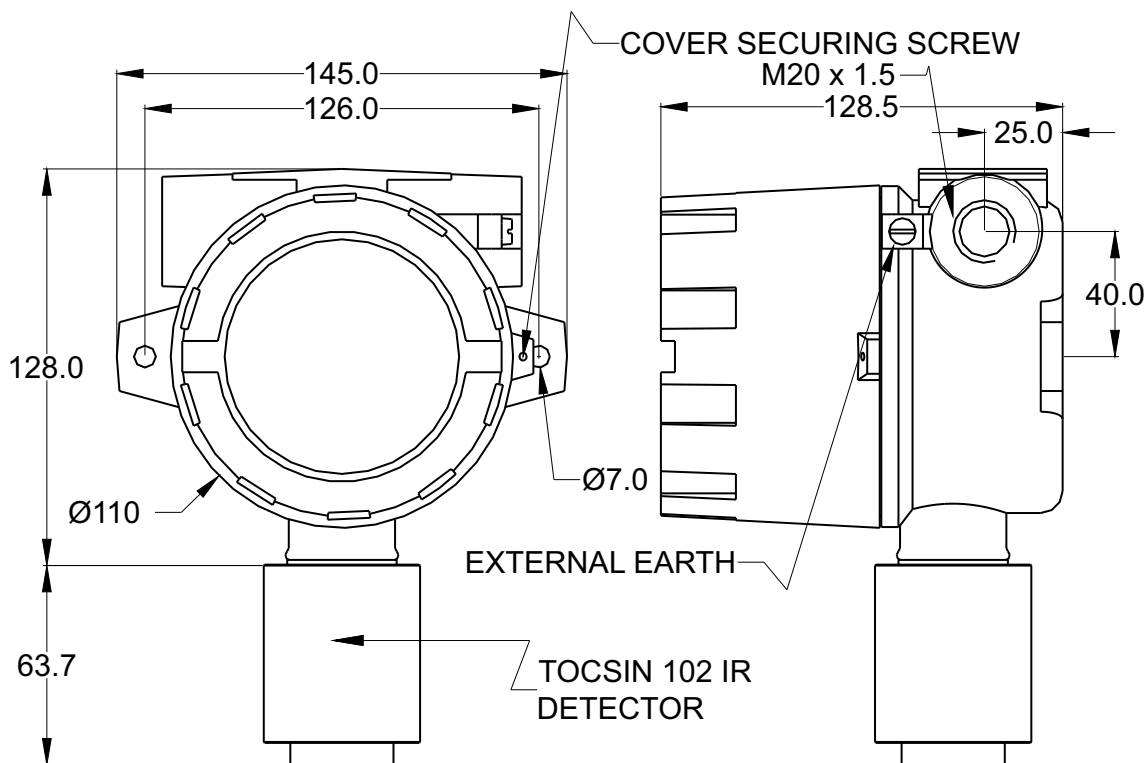

Standard Junction Box P/N 5045802
As Above Diagram

Weather Protection Assembly
Incorporating Test Gas Applicator P/N 401451

Collector Cone P/N 401061

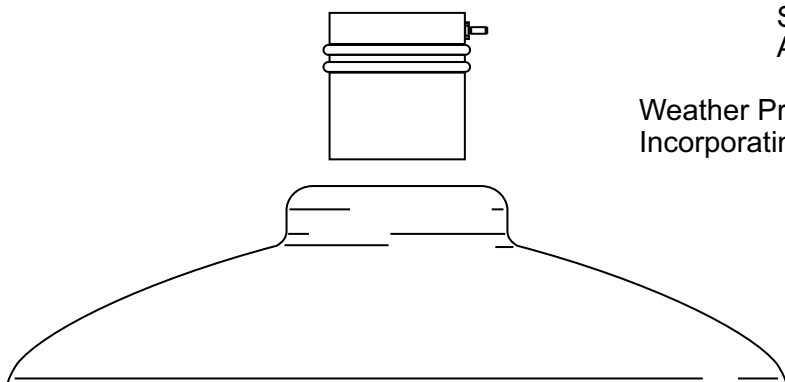

Engineers Test Gas
Applicator For Tocsin 102 P/N 401101A



Tocsin 102 Series H2S Detector
Fitted With 903 Series EXd
Single Channel Controller

For Compatible Oliver IGD Control Panels See:

- The Tocsin 625 Small System controller
- The Tocsin 700 One to 64 Channel Controller
- The Tocsin 920 Addressable System Controller
- The Tocsin 903 EEx Single Channel Controller